



MEMBER OWNED • COMMUNITY POWERED

WIRES DIVISION

CC# \_\_\_\_\_

Form #R12

ENERGIZE AUTHORIZATION FORM

RE: UNDERGROUND SECONDARY FARM SERVICE

REQUIREMENTS FOR ENERGIZATION

Prior to Battle River Power Coop (Wire Service Provider) energizing your service, you must ensure that the following requirements are met for your type of service. Once your service is ready, please contact our Utility Billing department and a work order will be issued.

PLEASE NOTE: Battle River's "Cost Efficient Energization Service" includes the Serviceman attending your site only ONCE; if your service is not ready for energization (requirements have not been met), a charge of \$250.00 plus G.S.T. will be applied to your Utility Billing Account each time we have to attend the site. Battle River Power Coop is a not-for-profit organization, operating at cost; efficiency and operations should not be compromised.

The member is required to: provide the underground cable and conduit (3 meters) and 4 feet of conduit to enter meter box (this can be done by your electrician if this is a new installation) up to the meter box located on the transformer pole. (Refer to picture 2.1) Battle River Power Coop will supply and install the meter and meter box on the transformer pole. You will also be required to provide a permit – see section Permit Required

DATE \_\_\_\_\_
NEW SERVICE \_\_\_\_\_ EXISTING SERVICE \_\_\_\_\_
ACCOUNT # \_\_\_\_\_
MEMBER NAME \_\_\_\_\_
MAILING ADDRESS \_\_\_\_\_
CITY/PROVINCE \_\_\_\_\_
PHONE HOME \_\_\_\_\_ BUSINESS \_\_\_\_\_
LSD Lot No. \_\_\_\_\_ Blk. No. \_\_\_\_\_ Plan No. \_\_\_\_\_ Sec. \_\_\_\_\_ Twp. \_\_\_\_\_ Rge. \_\_\_\_\_ W. of \_\_\_\_\_

PERMIT REQUIRED

INSTALLATION CANNOT BE ENERGIZED BEFORE BATTLE RIVER POWER COOP HAS RECEIVED A COPY OF THE APPROVED ELECTRICAL PERMIT. ALL ELECTRICAL EQUIPMENT INSTALLED MUST CONFORM TO CSA STANDARDS. BATTLE RIVER POWER COOP CANNOT ENERGIZE THE SERVICE UNTIL THE INSPECTION HAS BEEN COMPLETED ON YOUR FACILITIES AND IS ACCEPTABLE TO BOTH THE INSPECTION AUTHORITY AND BATTLE RIVER POWER COOP.

ELECTRICAL PERMIT (NEW SERVICE REQUIRED) \_\_\_\_\_
Please check and attach Electrician (print & sign)

ELECTRICAL PERMIT (IF SERVICE HAS BEEN DE-ENERGIZED FOR LONGER THAN ONE YEAR) \_\_\_\_\_
Please check and attach Electrician (print & sign)

This document serves as confirmation to Battle River Power Coop (the Wire Service Provider) that the electrical service referenced above has been constructed and complies with applicable codes, standards and regulations under the Alberta Safety Codes Act.

PRINT NAME \_\_\_\_\_

SIGNATURE \_\_\_\_\_

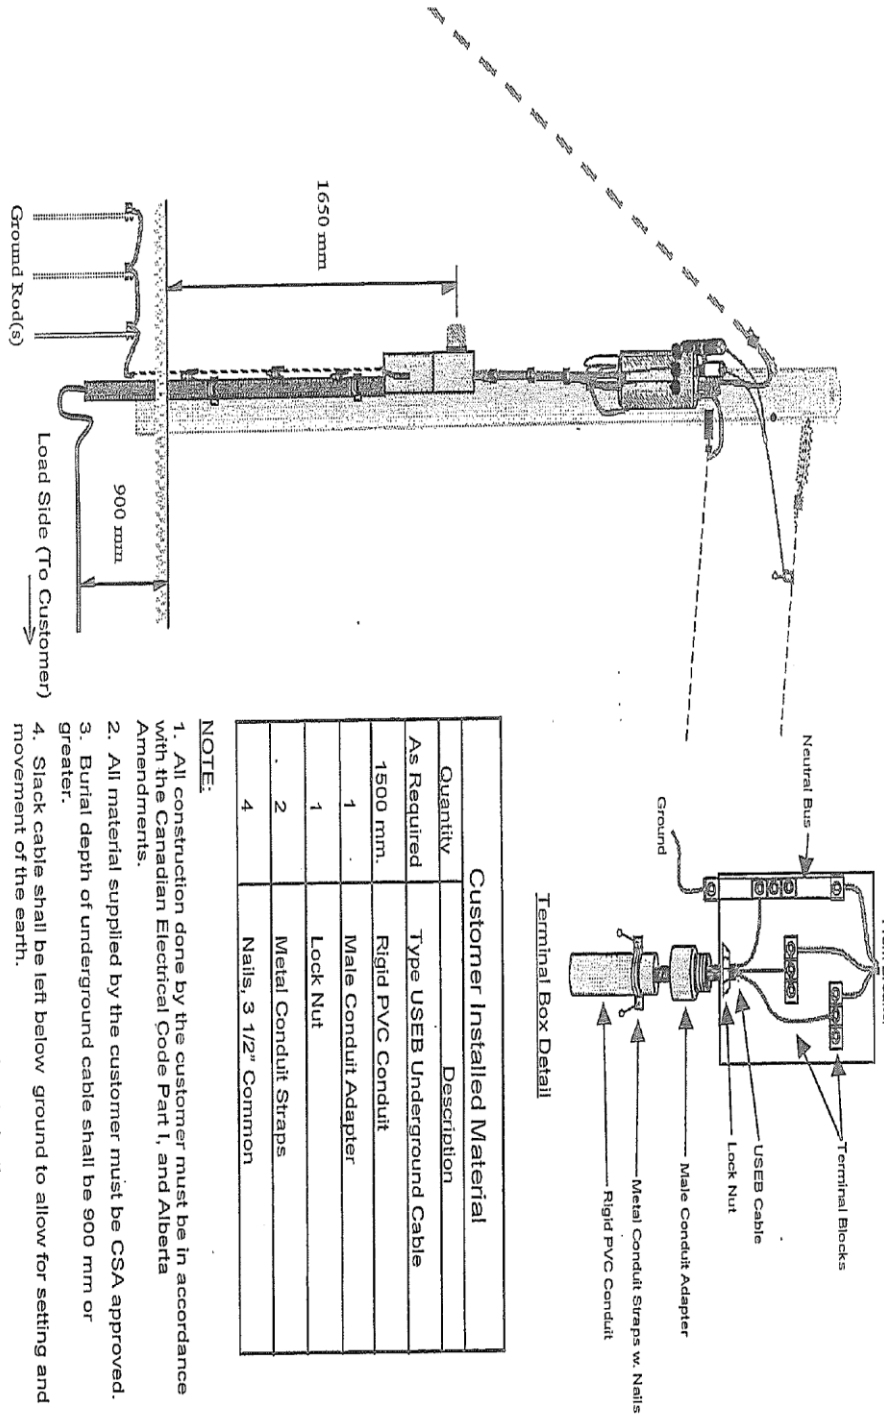


Figure 2.1  
Single Phase  
Underground Service from Overhead Pole

Quantity	Description
As Required	Type USEEB Underground Cable
1500 mm.	Rigid PVC Conduit
1	Male Conduit Adapter
1	Lock Nut
2	Metal Conduit Straps
4	Nails, 3 1/2" Common

**NOTE:**

1. All construction done by the customer must be in accordance with the Canadian Electrical Code Part I, and Alberta Amendments.
2. All material supplied by the customer must be CSA approved.
3. Burial depth of underground cable shall be 900 mm or greater.
4. Slack cable shall be left below ground to allow for setting and movement of the earth.
5. Conduit straps must be metal, not plastic
6. All dimensions are in millimetres.